
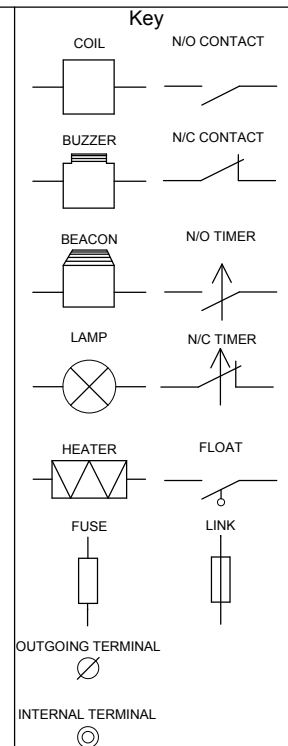


SIX  
HYDROVAR  
SUPPLY UNIT  
400v

DUTYPOINT LTD  
SHEPHERD Rd.  
COLE AVENUE  
GLOUCESTER  
GL2 6EL

Drawing No	Drawn by G.L.
Job No	Checked by T.B.
Sheet No 2 OF 3	Date 14/07/16

Rev No	Description	Date	Rev No	Description	Date	Rev No	Description	Date	Rev No	Description	Date
--------	-------------	------	--------	-------------	------	--------	-------------	------	--------	-------------	------

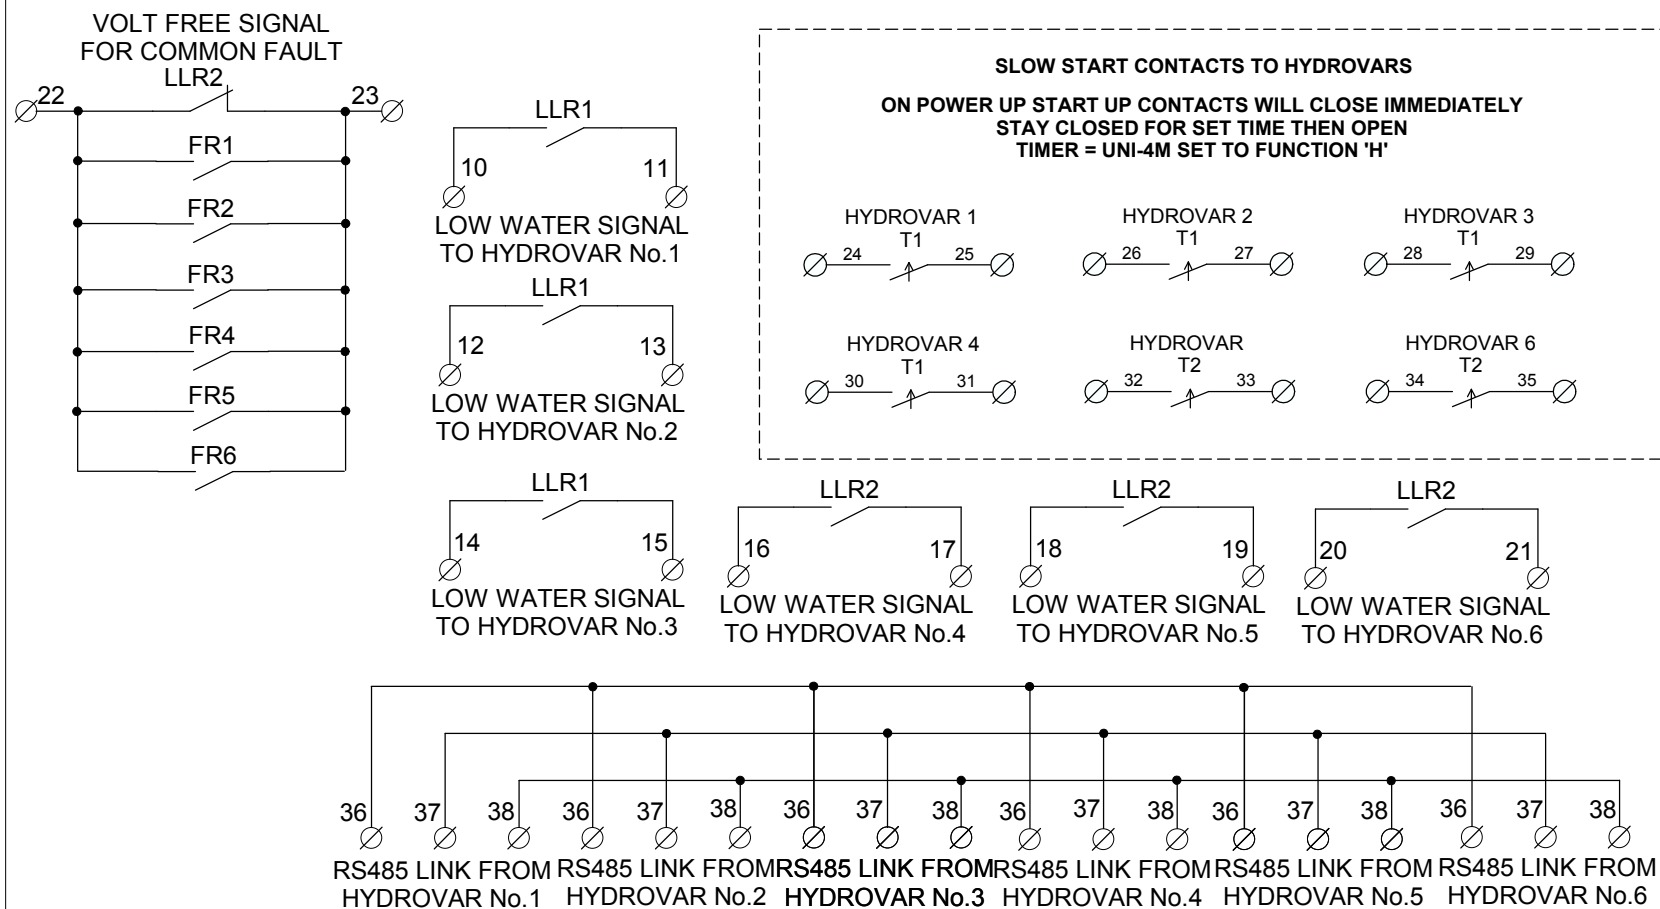

**TITLE**

**SIX  
HYDROVAR  
SUPPLY UNIT  
400v**

**DUTYPOINT LTD  
SHEPHERD Rd.  
COLE AVENUE  
GLOUCESTER  
GL2 6EL**

14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	36	37	38	36	37	38	36	37	38	36	37	38	36	37	38
LOW WATER SIGNAL TO HYDRO NO. 3		LOW WATER SIGNAL TO HYDRO NO. 4		LOW WATER SIGNAL TO HYDRO NO. 5		LOW WATER SIGNAL TO HYDRO NO. 6		VOLT FREE SIGNAL FOR COM FAULT		SLOW START CONTACTS TO HYDROVARS											RS485 LINK FROM HYDROVAR Nos.1, 2, 3, 4, 5 & 6																		

U1	V1	W1	E	U2	V2	W2	E	U3	V3	W3	E	U4	V4	W4	E	U5	V5	W5	E	U6	V6	W6	E	1	2	1	4	1	5	1	6	1	7	1	8	1	9	10	11	12	13
HYDROVAR No. 1				HYDROVAR No. 2				HYDROVAR No. 3				HYDROVAR No. 4				HYDROVAR No. 5				HYDROVAR No. 6				LOW LEVEL FLOAT	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	HYDRO FAILED	LOW WATER SIGNAL TO HYDRO NO.1	LOW WATER SIGNAL TO HYDRO NO. 2							

Rev No	Description	Date	Rev No	Description	Date	Rev No	Description	Date	Rev No	Description	Date	Drawing No		Drawn by G.L.		Job No		Checked by T.B.		Sheet No 3 OF 3		Date 14/07/16	
--------	-------------	------	--------	-------------	------	--------	-------------	------	--------	-------------	------	------------	--	------------------	--	--------	--	--------------------	--	--------------------	--	------------------	--